


ATTACHED SIDEWALK SECTION

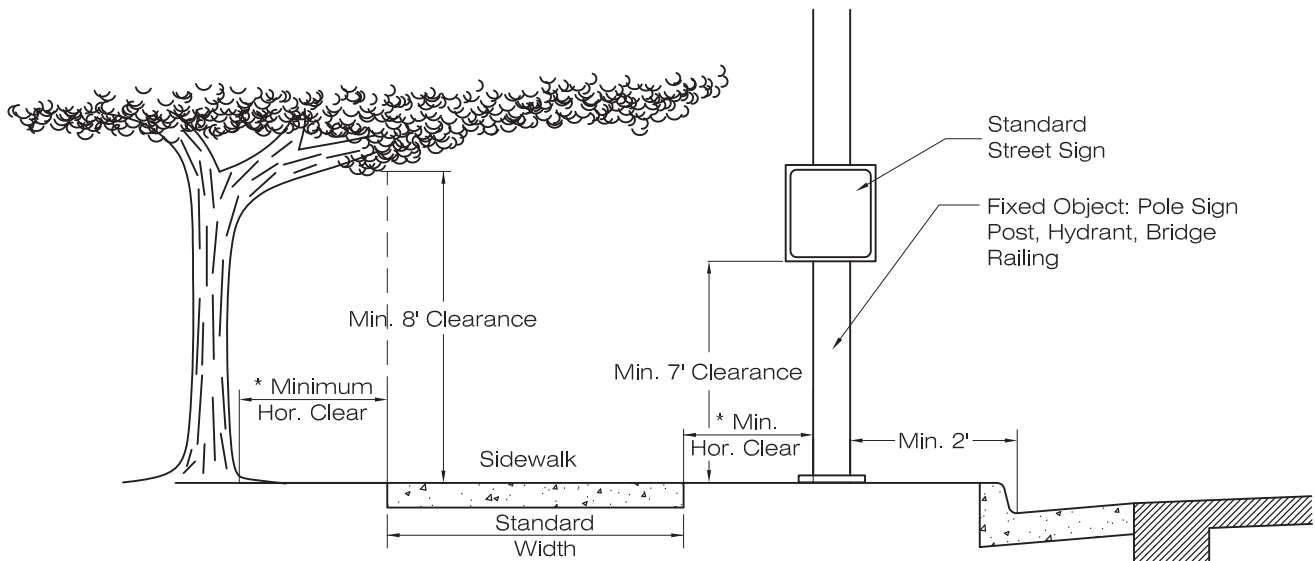

DETACHED SIDEWALK SECTION

**NOTE:**

1. All above ground utilities or other features must be a minimum of 2' from sidewalk.

\* The minimum horizontal clearance may be reduced by the Local Entity Engineer to zero feet in locations such as downtown, special pedestrian plazas and bridges, where bicycle traffic is restricted. In such locations the minimum clear path equal to the standard sidewalk width for the street classification shall be clear of all obstructions.

Objects & Materials	Minimum Horizontal Clearance
Trees	2.5'
Shrubs, Hedges	2'
Fences & Walls	2'
Solid Fixed Objects	1'
Movable Solid Objects	1'
Gravel, Rocks, or Material that may slough or land on the sidewalk	2'


**VERTICAL & HORIZONTAL CLEARANCES FOR SIDEWALKS**

**LARIMER COUNTY  
URBAN AREA  
STREET STANDARDS**

**DESIGN  
FIGURE**

**REVISION NO: 1**  
**DATE: 03/01/02**

**FIGURE  
16-1**

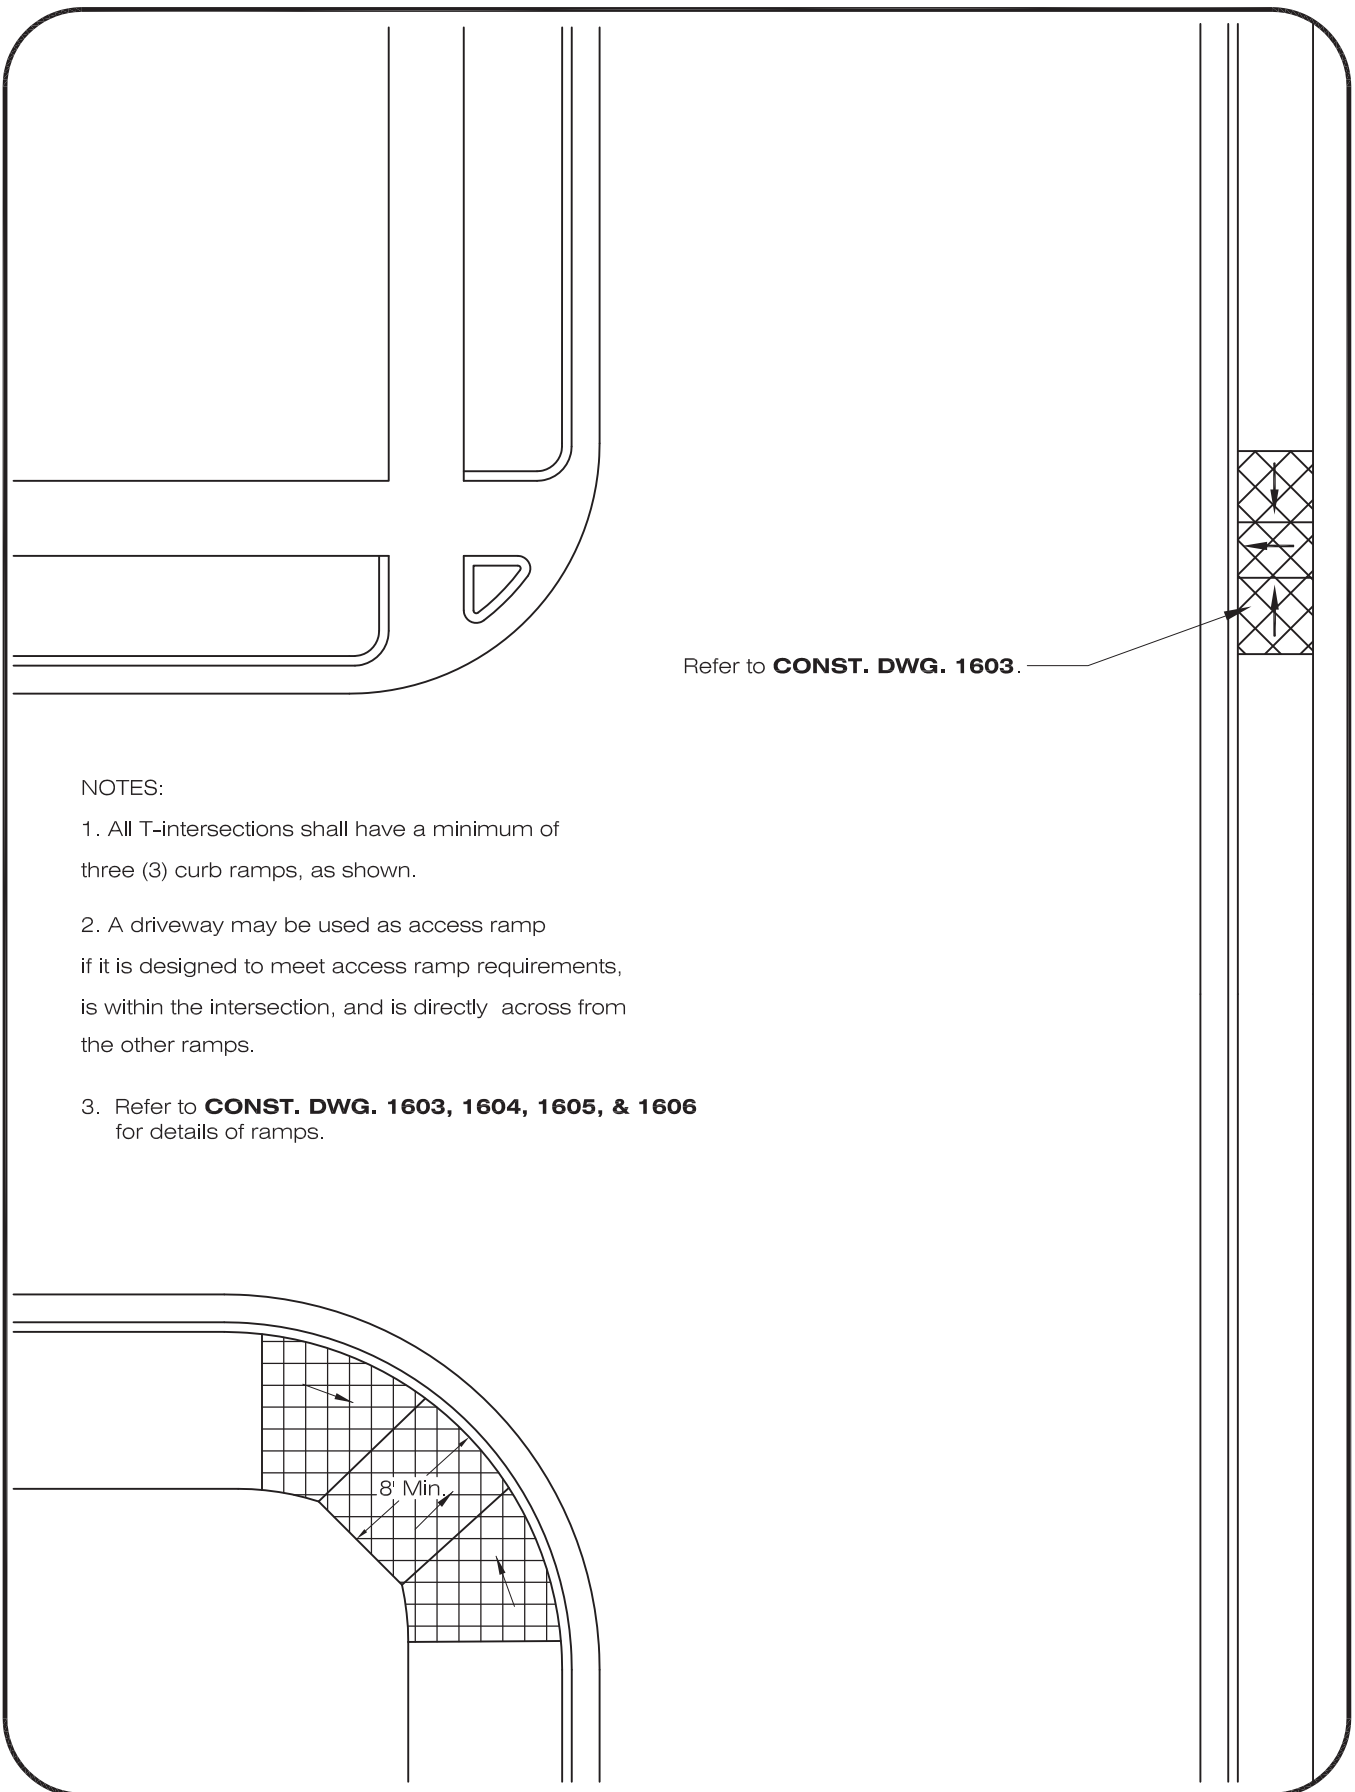

NOTES:

1. All T-intersections shall have a minimum of three (3) curb ramps, as shown.
2. A driveway may be used as access ramp if it is designed to meet access ramp requirements, is within the intersection, and is directly across from the other ramps.
3. Refer to **CONST. DWG. 1603, 1604, 1605, & 1606** for details of ramps.

## ACCESS RAMP LOCATION (T-INTERSECTION)

LARIMER COUNTY  
URBAN AREA  
STREET STANDARDS

DESIGN  
FIGURE

REVISION NO:	1
DATE:	03/01/02

FIGURE  
16-2